



SIDE VIEW
NOT TO SCALE

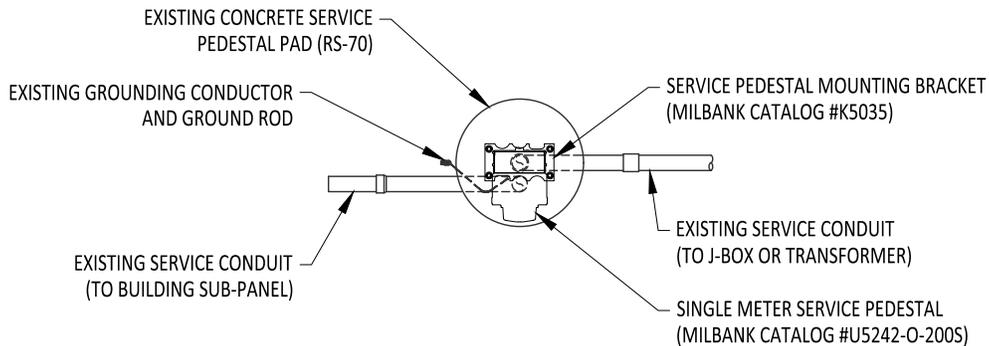

PLAN VIEW
NOT TO SCALE

NOTES:

1. ALL METERS SHALL HAVE A 36"x36" LEVEL WORK SPACE DIRECTLY IN FRONT OF METER.
2. WHEN CLEARANCES OR MINIMUM OFFSETS CANNOT BE MET, VEHICLE PROTECTION BOLLARDS SHALL BE INSTALLED PER DIRECTION BY A DESIGNATED CITY REPRESENTATIVE.
3. IF EXISTING PEDESTAL WAS BUILT WITHOUT ANCHOR BOLTS INSTALLED, CONTRACTOR TO MOUNT BRACKET WITH APPROVED CONCRETE ANCHORS.




**CITY OF
BOULDER CITY, CO**
**PUBLIC WORKS
DEPARTMENT
ENGINEERING
DIVISION**


**STANDARD DRAWING
ELECTRICAL INFRASTRUCTURE REQUIREMENTS**

**MANUFACTURED HOME
SINGLE METER SERVICE PEDESTAL**

CREATED BY:
M. GRIMES
ISSUE DATE:
02/20/18
FILE NAME:
BC-MH-PED.dwg
SHEET:
1 OF 2

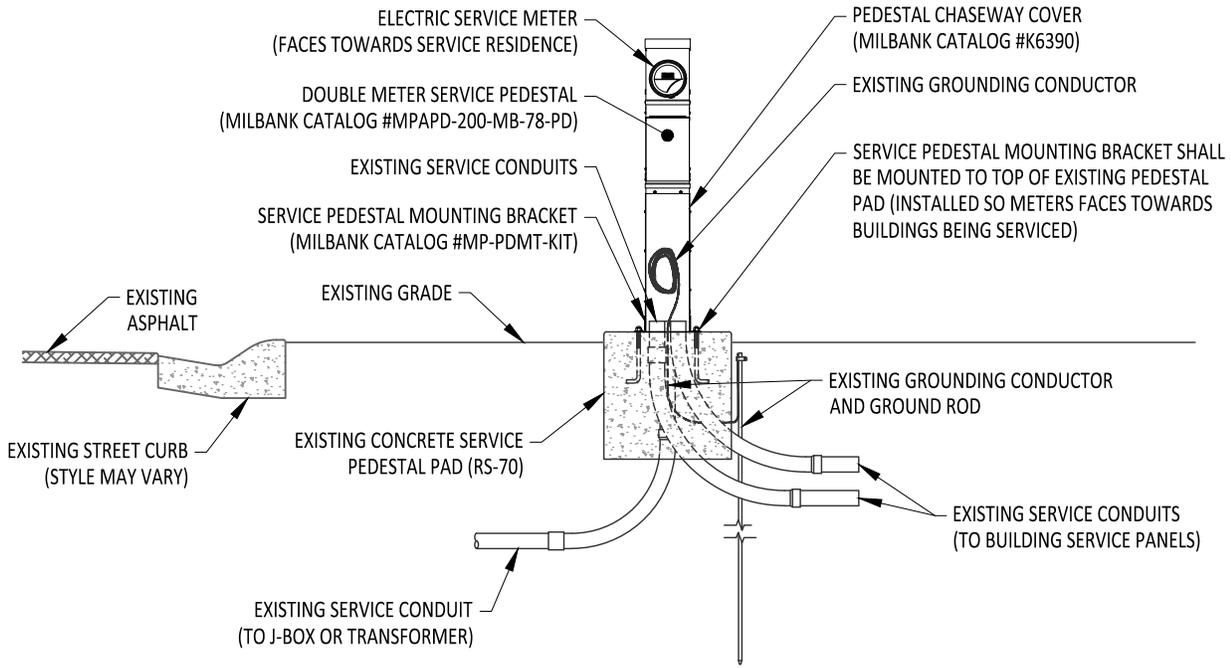


SIDE VIEW
NOT TO SCALE

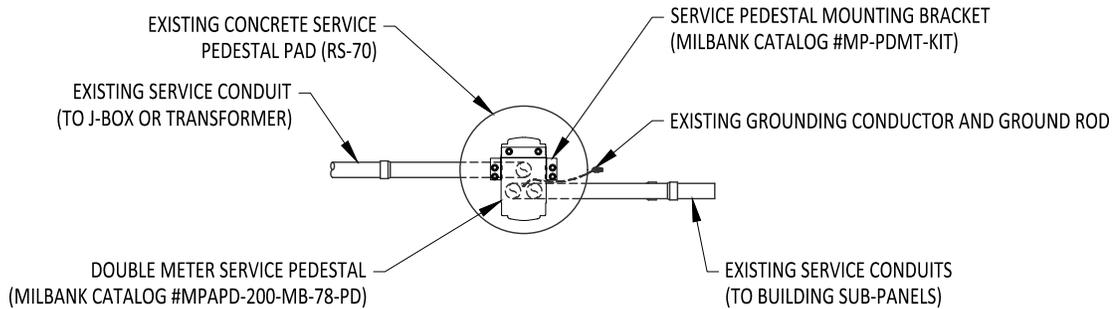

PLAN VIEW
NOT TO SCALE

NOTES:

1. ALL METERS SHALL HAVE A 36"x36" LEVEL WORK SPACE DIRECTLY IN FRONT OF METER.
2. WHEN CLEARANCES OR MINIMUM OFFSETS CANNOT BE MET, VEHICLE PROTECTION BOLLARDS SHALL BE INSTALLED PER DIRECTION BY A DESIGNATED CITY REPRESENTATIVE.
3. IF EXISTING PEDESTAL WAS BUILT WITHOUT ANCHOR BOLTS INSTALLED, CONTRACTOR TO MOUNT BRACKET WITH APPROVED CONCRETE ANCHORS.



**CITY OF
BOULDER CITY, CO**
**PUBLIC WORKS
DEPARTMENT
ENGINEERING
DIVISION**

**STANDARD DRAWING
ELECTRICAL INFRASTRUCTURE REQUIREMENTS**

**MANUFACTURED HOME
DOUBLE METER SERVICE PEDESTAL**

CREATED BY:
M. GRIMES
ISSUE DATE:
02/20/18
FILE NAME:
BC-MH-PED.dwg
SHEET:
2 OF 2